


METER SPACING

SIZE OF METER	DIMENSION "A"	DIMENSION "D"
1-1/2"	30"	60"
2"	30"	60"

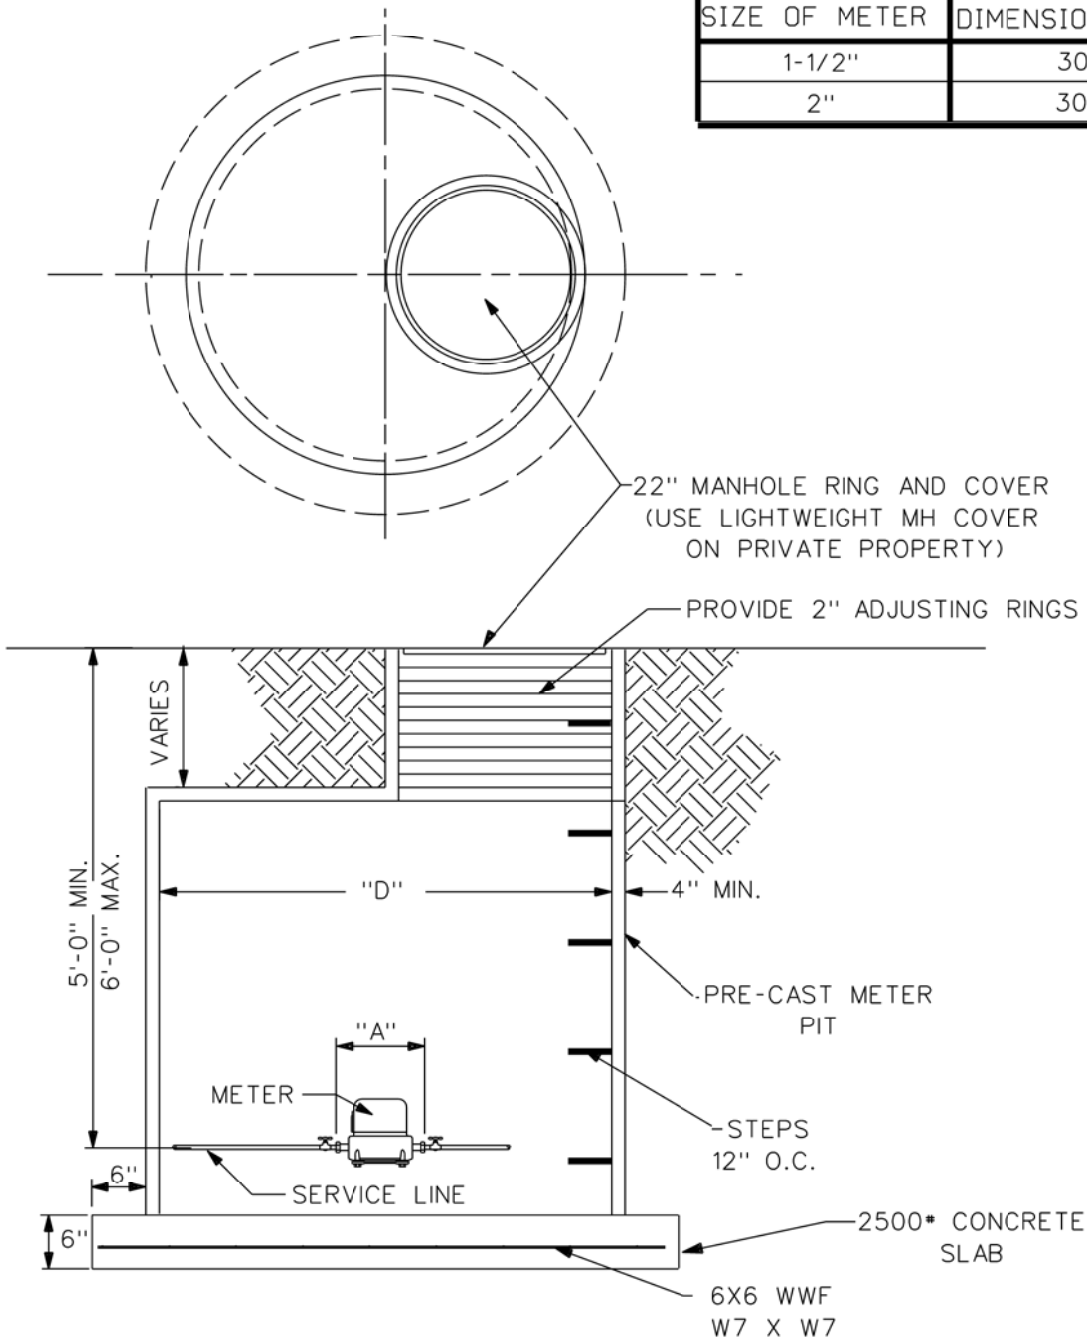

NOTE:

1. INCREASE DIAMETER OF PIT 12" FOR EACH ADDITIONAL METER TO BE INSTALLED.
2. INSTALL DIRECT BURY TELEPHONE CABLE FROM METER PIT TO CMR UNIT INSIDE THE BUILDING.
3. DIMENSION "A" IS FACE TO FACE OF VALVES

SCALE: NONE

URBANDALE WATER
UTILITY

DETAIL OF THE STANDARD
METER PIT - 1-1/2" & 2"
DISC METERS

DATE: 07-01-2013